
## <u>ITEM</u> A SERVICE DISCONNECT (SEE NOTE 2)

	/ \	SLIVIUL DISCUMNLUT (SLL NOTL Z)
•	В	AUTOMATIC TRANSFER SWITCH (SEE NOTE 2)
	С	DUPLEX PUMP CONTROL PANEL (SEE NOTE 2 & 3)
	D	RTU PANEL — FIBERGLASS
	E	POLYPHASE COAXIAL CABLE SURGE ARRESTOR
	F	COAX CABLE FROM ANTENNA
	G	MINIMUM 3" GALVANIZED POSTS
	Н	GFCI PROTECTED OUTLET

DRY TRANSFORMER-10kVA (SEE NOTE 4)

## NOTES:

- 1. ALL POWER TO THE PUMP STATION SHALL BE THREE PHASE POWER. PUMP STATIONS 10 HP AND SMALLER MAY HAVE SINGLE PHASE POWER.
- TRANSFER SWITCH, DUPLEX PUMP PANEL, AND SERVICE DISCONNECT SHALL BE STAINLESS STEEL.
- 3. THE DUPLEX PUMP PANEL SHALL HAVE A FACTORY APPLIED WHITE PAINT FINISH AND 3-POINT LOCKABLE HATCH.
- 4. 10KVA DRY TRANSFORMER REQUIRED FOR 480 VAC PRIMARY.
- PROVIDE A MINIMUM OF THREE 10' LONG 3" DIAMETER COPPER CLAD GROUND RODS SPACED A MINIMUM OF 20' APART, EXOTHERMICALLY WELDED AND BONDED TOGETHER WITH INSPECTION WELLS AT EACH CONNECTION. ONE GROUND ROD LOCATED AT TOWER, ELECTRIC METER, AND GENERATOR.
- 6. METER BASE, SCADA/RTU PANEL, AND FLOW METER ENCLOSURE (IF APPLICABLE) MAY BE MOUNTED ON THE BACK IF THERE IS NO ROOM ON THE FRONT. SERVICE DISCONNECT, ATS, AND PUMP CONTROL PANEL MUST BE MOUNTED TOGETHER ON THE FRONT AND <u>FACE</u> <u>WET WELL</u>
- 7. USE ADEQUATE AMOUNT OF 1 & SLOTTED STAINLESS STEEL UNISTRUT TO SUPPORT ALL ENCLOSURES. EACH ENCLOSURE SHALL BE SUPPORTED BY A MINIMUM OF TWO HORIZONTAL PIECES OF UNISTRUT.
- 8. ALL CONDUIT ENTRIES MUST PENETRATE THE BOTTOM OF ALL ENCLOSURES WITH MYERS HUB TYPE FITTINGS, NO EXCEPTIONS. NO CONDULET FITTINGS (LL, LB, OR LR) ALLOWED.
- 9. ALL CONDUIT SHALL BE SCHEDULE 80 PVC.
- 10. ALL ENCLOSURE LABELS SHALL BE OUTDOOR VINYL LABELS AND SHALL BE MOUNTED TO THE ENCLOSURE WITHOUT ANY DRILLING OF THE ENCLOSURE.
- 11. ALL POWER WIRES AND CONTROL WIRES MUST BE PROPERLY AND PERMANENTLY LABELED ON BOTH ENDS OF WIRES, NO EXCEPTIONS.
- 12. INSTALL NON-HARDENING DUCT SEALANT ON ALL

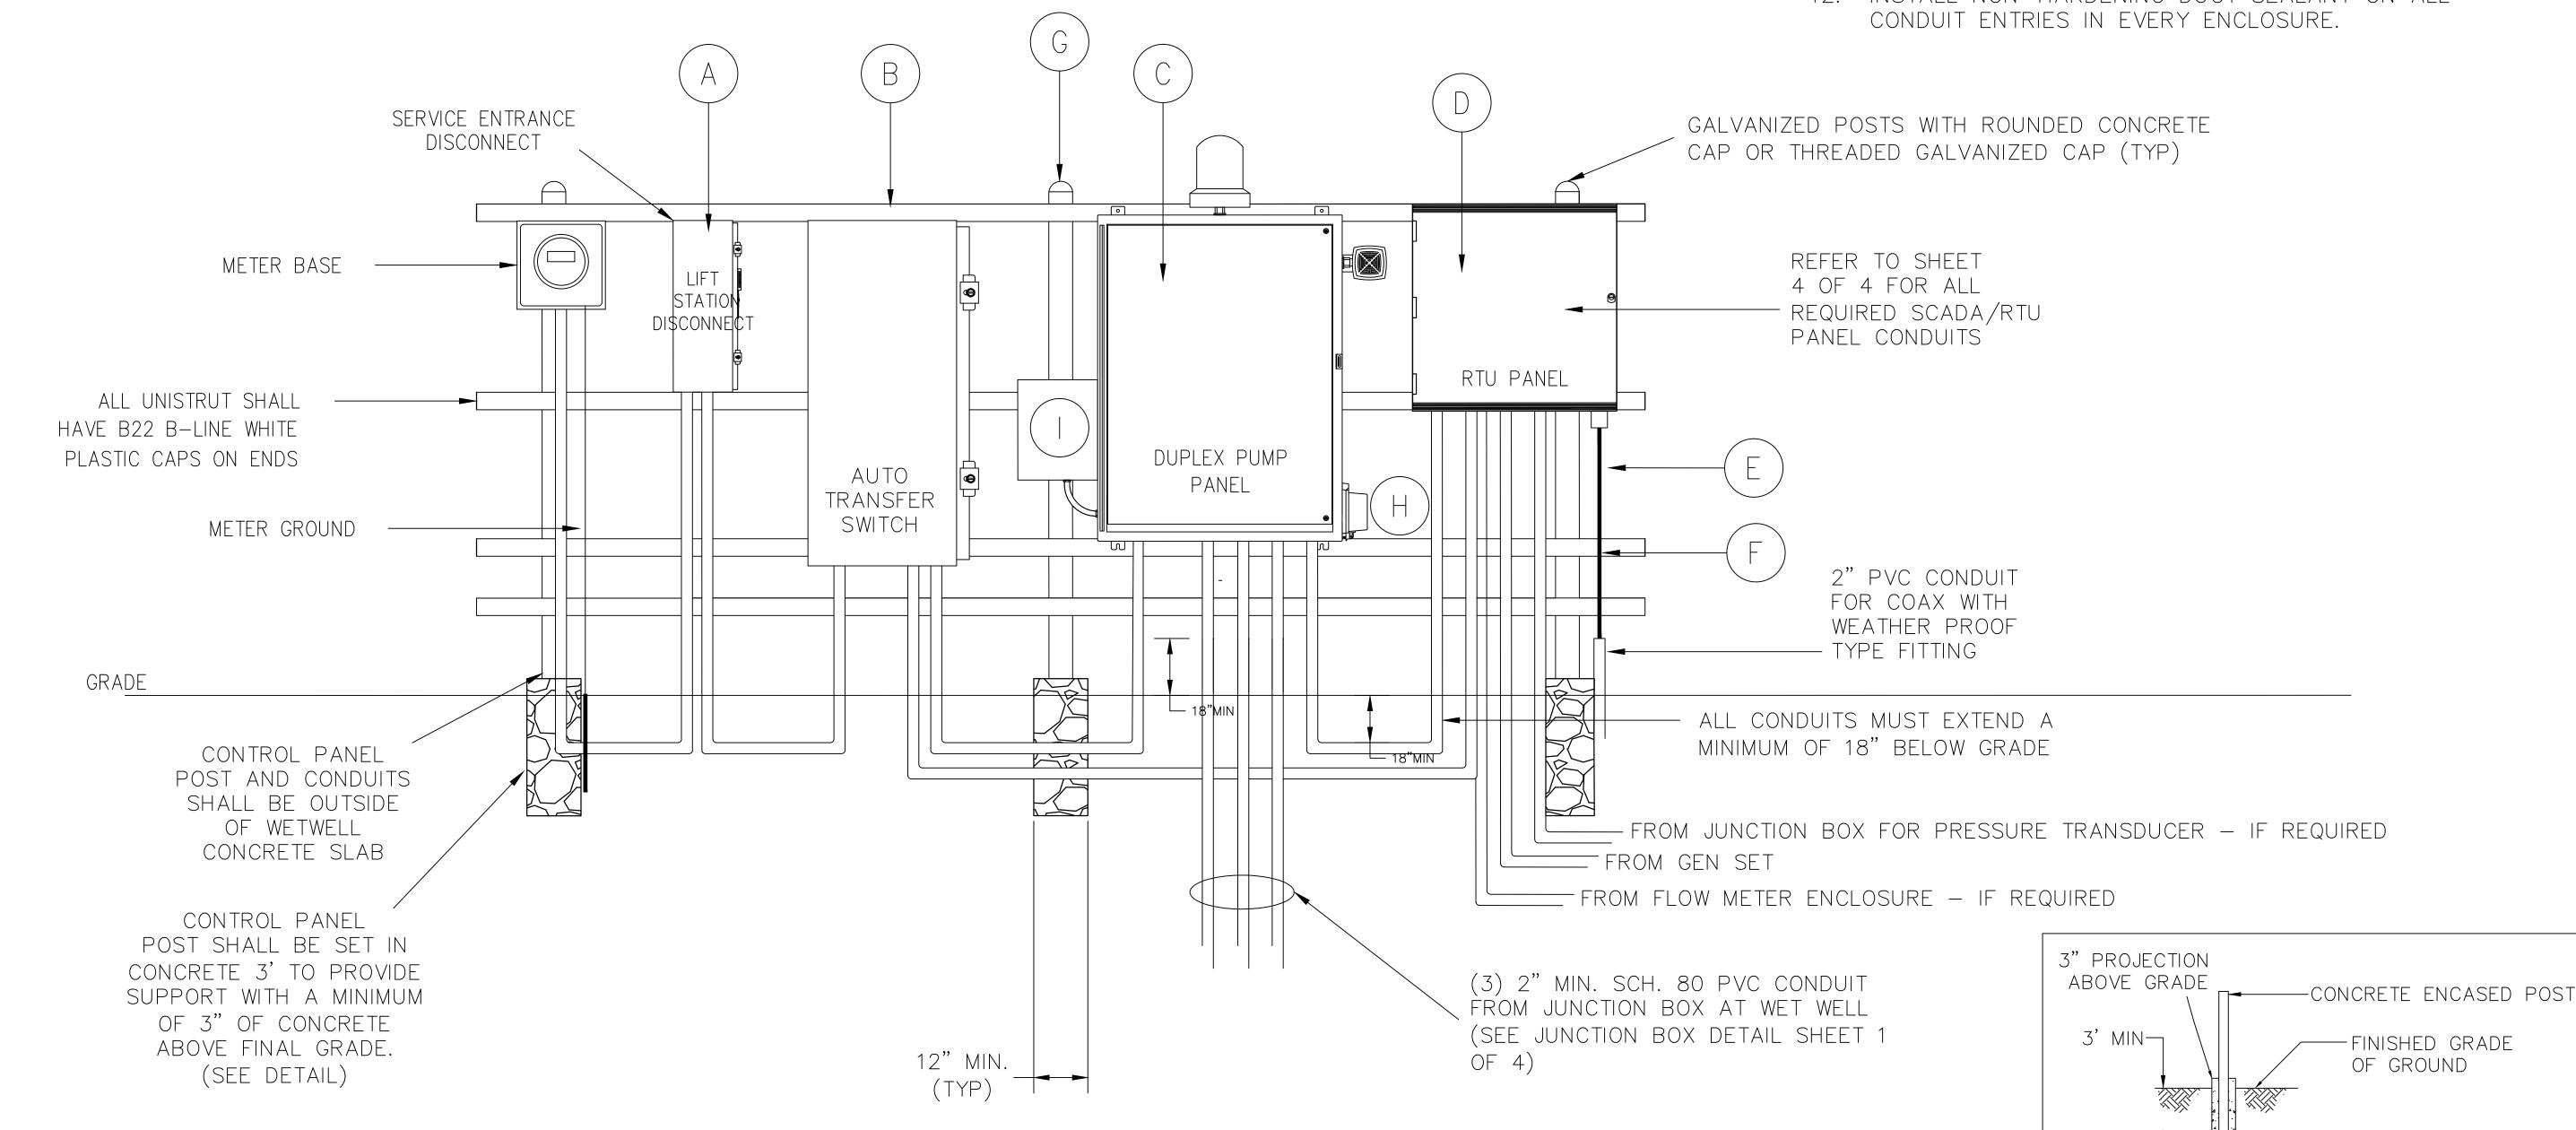

NTROL PANEL ELEVATION

NOT TO SCALE

1.1 - DATED 10/15/2013 Added Note for Flow Meter Enclosure

1.2 - DATED 3/28/2017 Note 5 Revision 1.3 - DATED 5/1/2017 Note Revisions
1.4 - DATED 5/22/2019
Detail Revisions

Date: <u>04-24-12</u> Scale: NTS Checked By: WLP

3 OF 4

6" MIN EACH SIDE

CONTROL PANEL POST DETAIL